


CURB & GUTTER and SIDEWALK

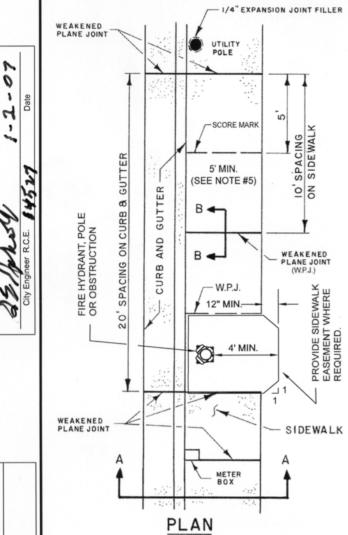

Approved by

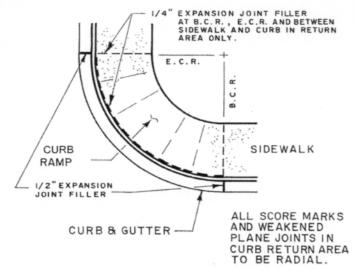


STANDARD RETURN

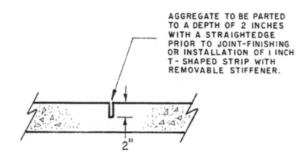

SECTION B-B

NOTES:

- NO PORTION OF DRIVEWAY APPROACH SHALL FALL WITHIN RETURN AREA.
- 2. CLASS 520-C-2500 (5-1/2 SACK) PC.C. SHALL BE USED.
- 3. TYPE I (CLEAR) CURING COMPOUND SHALL BE USED.
- FINISH SIDEWALK WITH FINE BROOM AT RIGHT ANGLE TO CURB. COARSE BROOM ON CURB RAMPS.
- SIDEWALK SHALL BE MINIMUM 8 FT. WIDTH WHERE TREE WELLS ARE REQUIRED.
- FOR SIDEWALK REPLACEMENT, FULL PANEL REMOVAL AND REPLACEMENT REQUIRED.

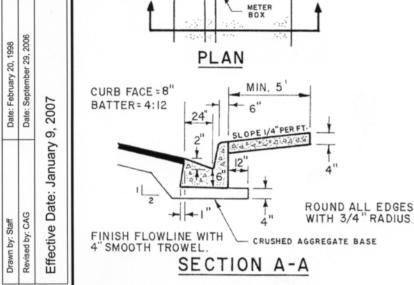



City of Glendora
Public Works Department
STANDARD DESIGNS & SPECIFICATIONS

Adopted for use on Public and Private Improvements

S.D.& S. NO.

1.02

Page 1 of 1